

UVGERMI®

ULTRAVIOLETS DE HAUTE TECHNOLOGIE

*Specialist in
microbiological water treatment
using ultraviolet reactors.*

● ○ ● MADE IN FRANCE

14000156_A_FT10

GERMI AD 120 ACS

> **Flow rate:** from 3.7 to 10.9 m³/h

Full warranty: 2 years

After-sales in France



The treatment of water for human consumption in communal facilities requires equipment that has been ACS-UV accredited in compliance with the decree of 9 October 2012 on the conditions of selling and using reactors with UV radiation lamps for the treatment of water for human consumption.

TECHNICAL SPECIFICATIONS

ACS UV no.: 24 UV LY 005, Certificate provided on request.

UV LAMP

Total electrical power:	120 Watts (1 lamp)
Germicidal power:	38 Watts UVC
Lamp service life:	16,000 hours or 2 years (maximum limit of 5 starts per 24-hour period)

UV REACTOR

Treatment chamber:	Stainless steel 316L
Input/Output:	DN 80
Operating pressure:	8 bars
Drainage valve and sampling valves	
UV sensor (permanent display of the intensity emitted)	
Fixing lugs	

ELECTRICAL BOX

Dimensions (mm):	190 x 204 x 72
Power supply:	240 V / 50-60 Hz
On/off switch / Lamp operation indicator / UV sensor display / Fault light indicator / Lamp hour counter	

ASSOCIATED PRODUCTS

120 W UV lamp:	14000094
Quartz sleeve:	15000804
O-ring:	14000113

OPTIONS

Manual cleaning by pull tab / Temperature probe / Vertical installation


www.uvgermi.fr

UVGERMI, ZAC de la Nau, 19240 Saint-Viance (FRANCE) // Tel. +0033(0)5 55 88 18 88 // Fax: +0033(0)5 55 88 18 16 // Email: contact@uvgermi.fr

14000156_A_FT10

GERMI AD 120 ACS

> **Flow rate:** from 3.7 to 10.9 m³/h

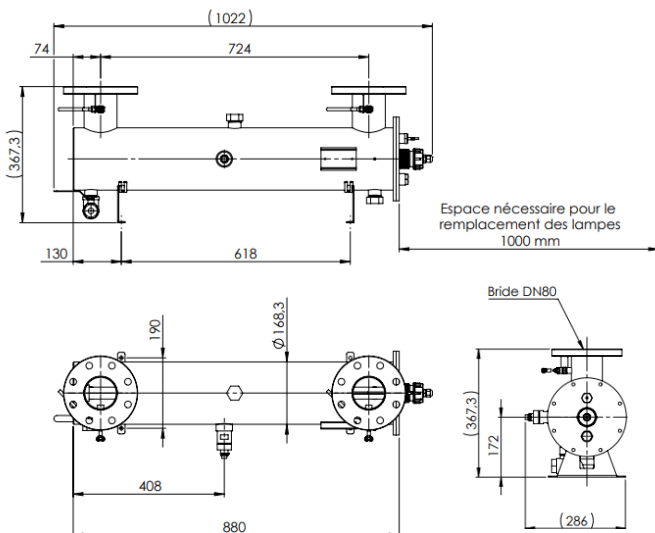

ACCREDITED FLOW RATES

TYPICAL VALUES FOR 400 J/m ²	
Maximal flow (m ³ /h)	Transmittance at 254 nm over 10 nm (%)
3.7	85
5.4	90
8.7	95
10.9	98

INSTALLATION

The **GERMI AD 120 ACS** is installed horizontally on the main water supply pipe. The water must flow in the direction indicated by the arrows on the UV chamber. Shut-off valves must be installed upstream and downstream of the unit.

Sufficient space must be left beside the lamp exit (at least 1 m) or allow for easy dismantling of the unit (bypass) for maintenance operations. Pay attention to the accumulation of air in the upper part and install an air bleed if necessary.

MAINTENANCE

The reactor requires little maintenance or monitoring: check lamp service life and clogging of the quartz sleeve. Effectiveness will be reduced when the lamp approaches the end of its service life. It must be replaced every 16,000 hours or every 2 years.

The quartz sleeve makes lamp replacement much easier: the unit does not have to be drained or dismantled. The sleeve may become clogged and should be cleaned 1-3 times per year with a mild acid, depending on the nature of the water. The quartz sleeve must be replaced every 4 to 5 years.