

©Shutterstock.com



# UVGERMI®

ULTRAVIOLETS DE HAUTE TECHNOLOGIE

*Treatment solutions for sea water using ultraviolet reactors.*

● ○ ● MADE IN FRANCE

16000314\_A\_FT10

## GERMI BP 75 HDPE

> **Flow rate:** from 8 to 13 m<sup>3</sup>/h

The **GERMI BP 75 HDPE** is specially designed to prevent the development of diseases in aquariums and fish farm ponds by destroying the parasites, bacteria and viruses in the sea water without using chemical substances that are toxic for marine organisms. The HDPE body offers excellent resistance to all corrosive atmospheres.



**Warranty:** 1 year  
**After-sales in France**

### TECHNICAL SPECIFICATIONS

Equipment to treat an average water flow of 8 m<sup>3</sup>/h (at 40 mJ/cm<sup>2</sup>) to 13 m<sup>3</sup>/h (at 25 mJ/cm<sup>2</sup>) with water quality transmittance of 90% at 254 nm over a 10 mm thickness.

#### UV LAMP

**Total electrical power:** 150 Watts (2 lamps)  
**Germicidal power:** 50 Watts UVC  
**Lamp service life:** 9,000 hours or 1 year

#### ELECTRICAL BOX

**Dimensions (mm):** 360 x 255 x 152  
**Protection rating:** IP 20  
**Power supply:** 230 V / 50-60 Hz  
**On/off switch / UV sensor / Lamp operation indicator / Lamp fault buzzer / Hour counter**

#### UV REACTOR

**Treatment chamber:** HDPE  
**Input/Output:** RU PVC63 / DN 50  
**Operating pressure:** 6 bars  
**Bleed valve and drainage valve**  
**1 cap to replace one of the valves**  
**Welded support lugs**


#### ASSOCIATED PRODUCTS

**75 W UV lamp:** 14000137  
**Quartz sleeve:** 14000051  
**O-ring:** 15000335

16000314\_A\_FT10

## GERMI BP 75 HDPE

> **Flow rate:** from 8 to 13 m<sup>3</sup>/h

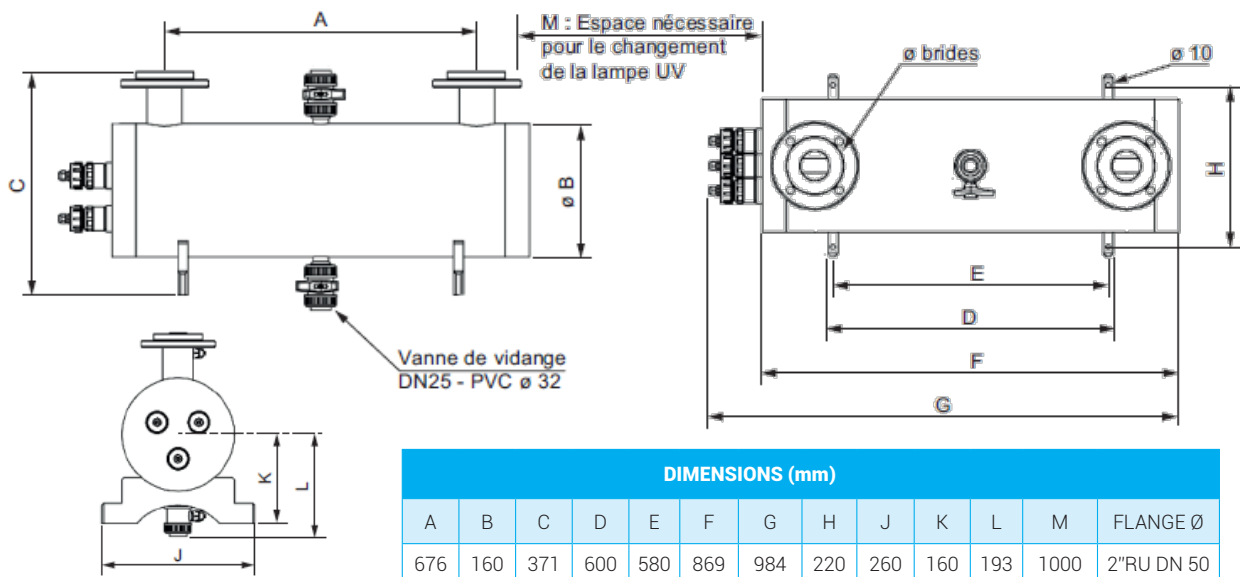

## INSTALLATION

The **GERMI BP 75 HDPE** is installed on the main water supply pipe. **It should be positioned horizontally**, water entry and exit are equivalent. Sufficient space must be left beside the lamps (at least 1 m) or allow for easy dismantling of the unit (bypass) to replace the UV lamps.

**If the reactor must be installed vertically**, it must be equipped with an automatic air bleed in the upper part. If applicable, we recommend having the water enter via the bottom and exit via the top of the reactor.

The device must be protected against "water hammer" using a water hammer protection device (pressure vessel, shock absorber, etc.) if needed. It must also be protected from freezing or very hot temperatures. **We strongly recommend installing a filter upstream of the unit** to reduce the particles that might mask the UV radiation.

## MAINTENANCE

Maintenance is limited to the replacement of the UV lamps and the replacement or cleaning of the sleeves. The UV lamps have a maximal service life of 9,000 hours, after which water disinfection is no longer guaranteed. The quartz sleeves protecting the lamp make lamp replacement much easier. The quartz sleeves may become clogged or deposits may form. They can be cleaned with mild acid.